



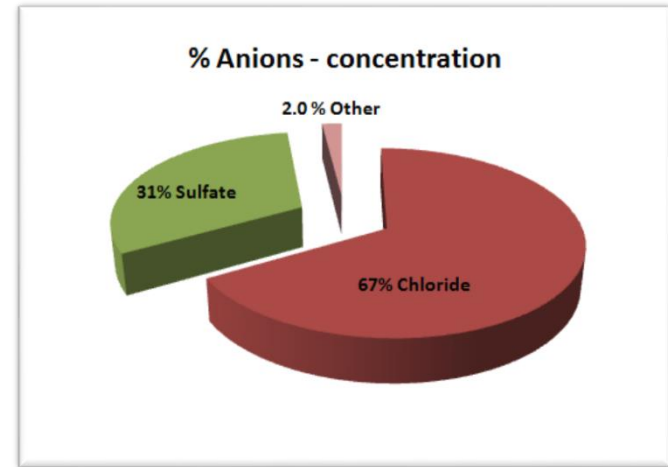

Flue Gas Desulfurization Application - Georgia Power 1 Year Test, 1 liter/min

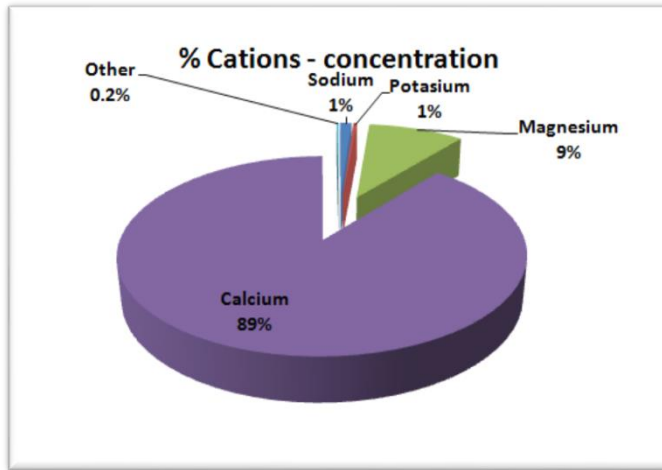

Species	Inlet (ppm)	Outlet (ppm)	% Reduction
TDS	5,094	1,249	76%
Selenium	137 ppb	19 ppb	87%
Mercury	4.1 ppb	0.86 ppb	79%